



S:\PROJECTS\B21.1179_CARRIZO_SPRINGS_WATER_SYSTEM\GIS\MXD\FIG07B_PIPES_WITH_LEAKS_INSIDE_PROJECT_BOUNDARY.MXD

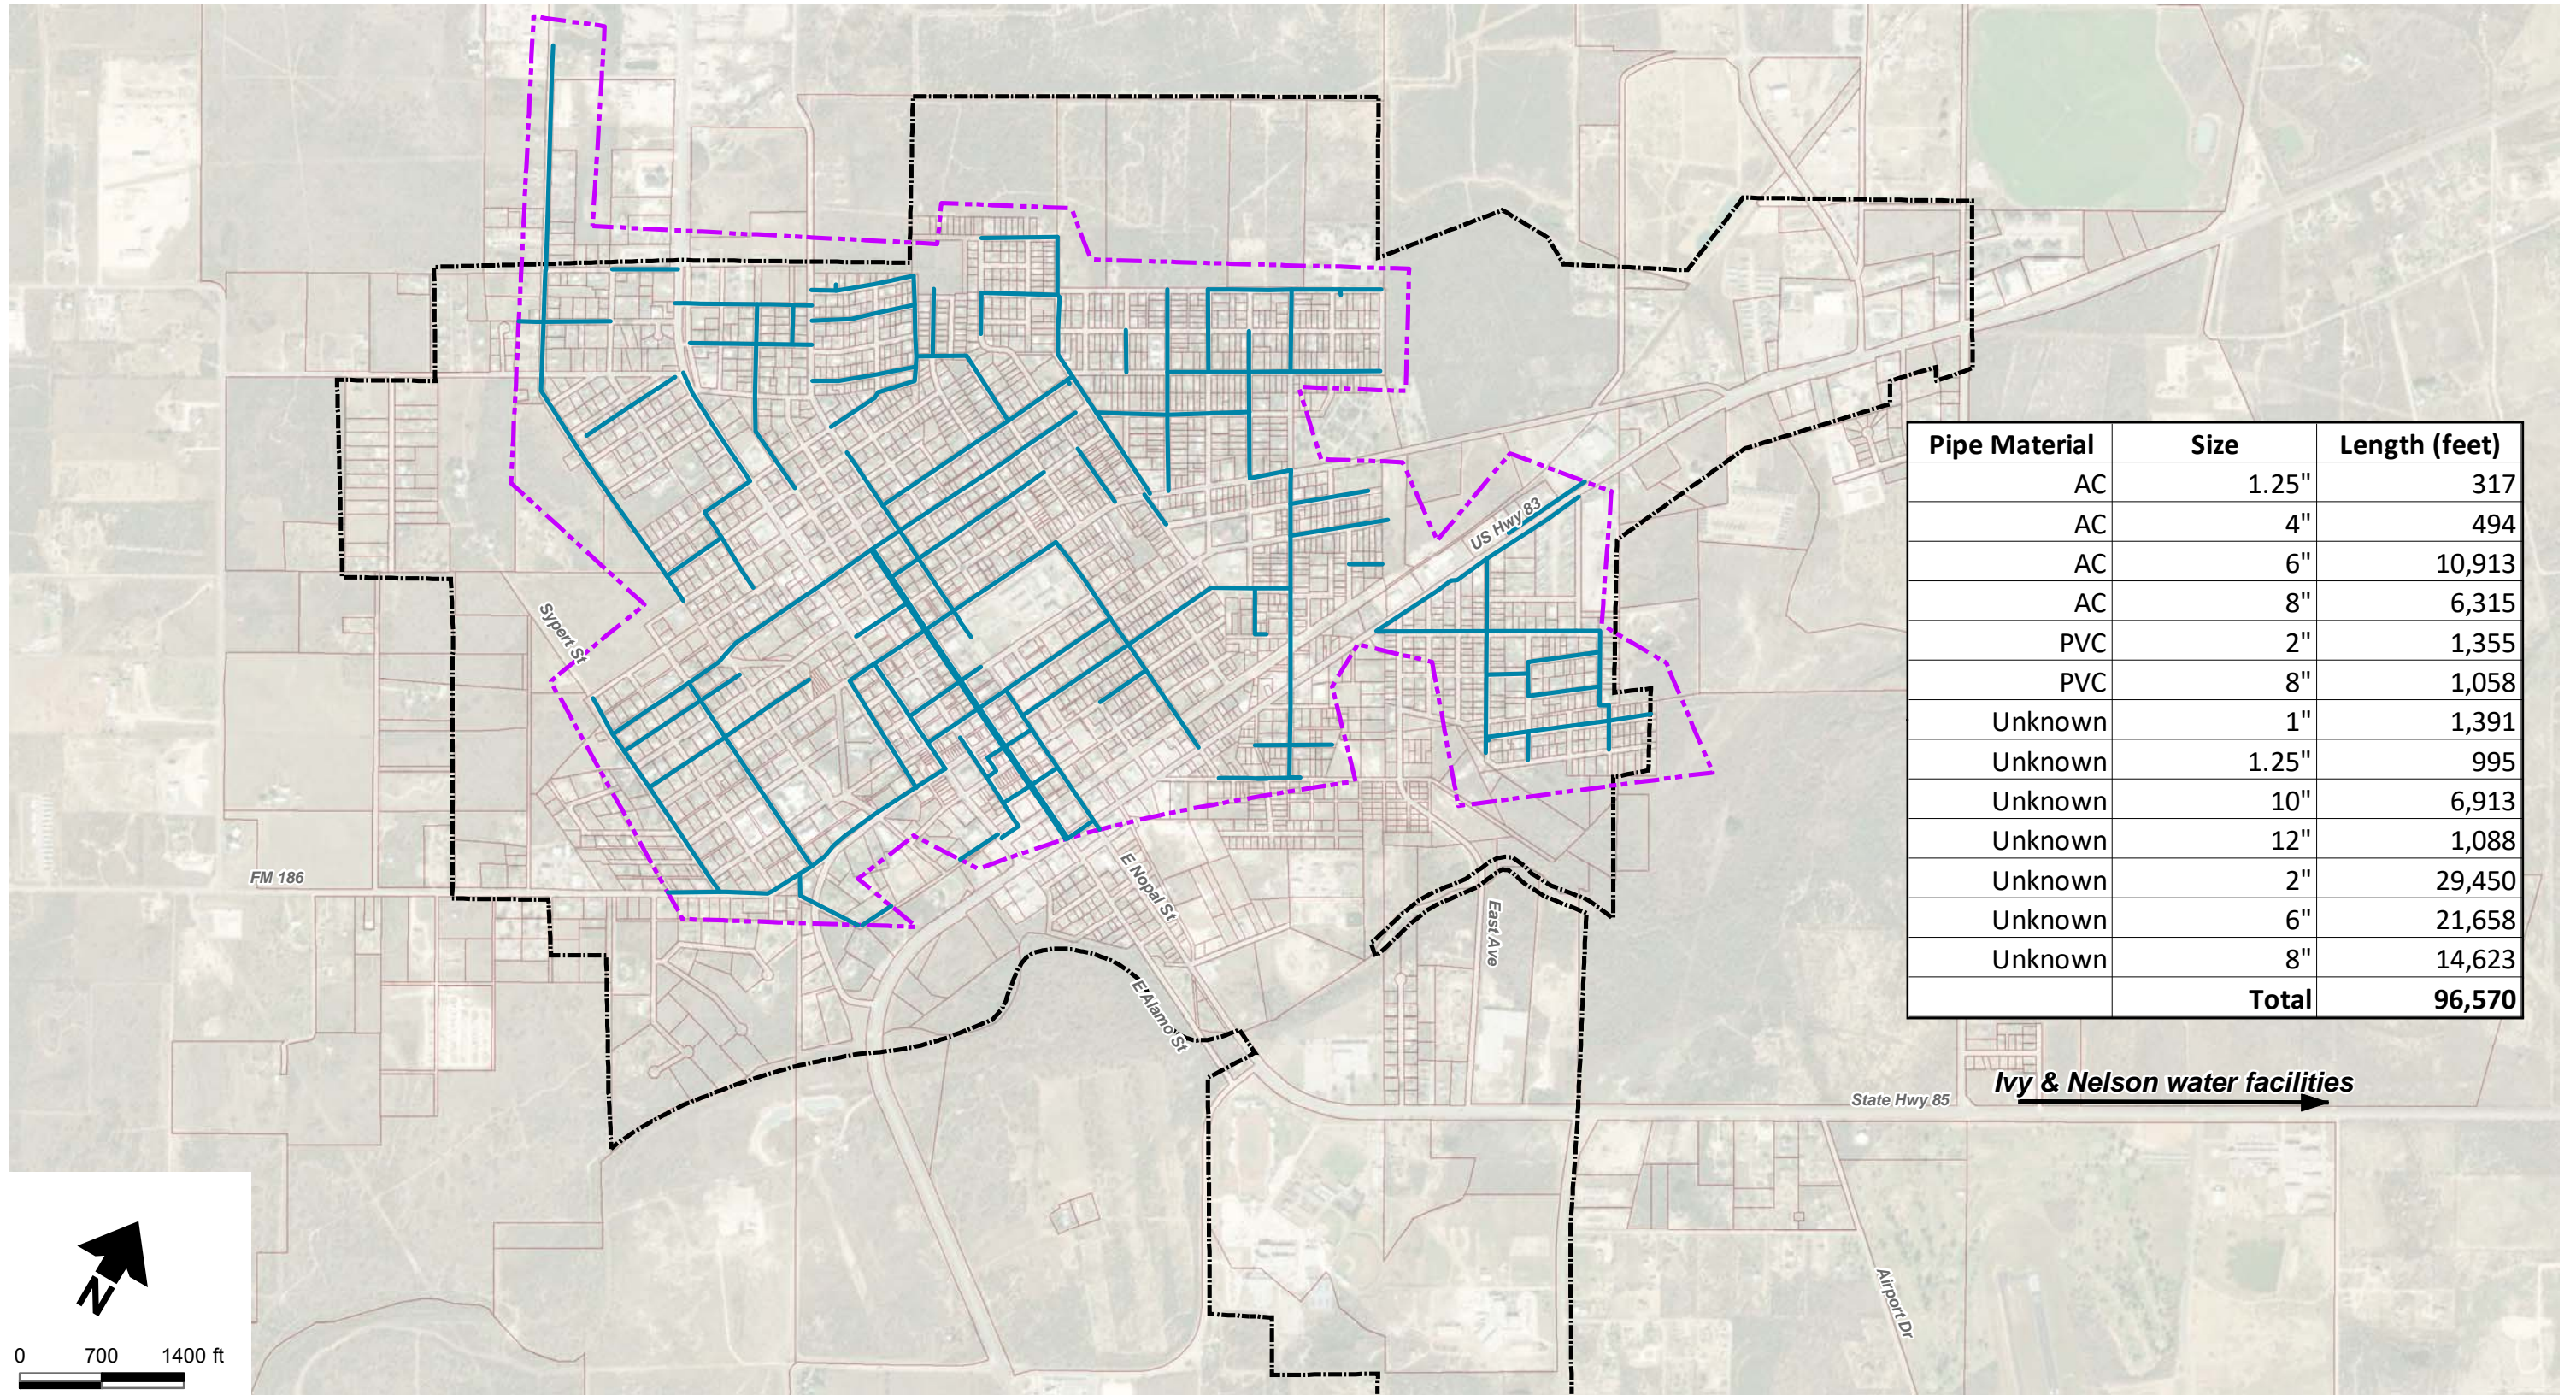

Pipe Material	Size	Length (feet)
AC	1.25"	317
AC	4"	494
AC	6"	10,913
AC	8"	6,315
PVC	2"	1,355
PVC	8"	1,058
Unknown	1"	1,391
Unknown	1.25"	995
Unknown	10"	6,913
Unknown	12"	1,088
Unknown	2"	29,450
Unknown	6"	21,658
Unknown	8"	14,623
	Total	96,570



Explanation

- Carrizo Water System pipe with identified leak(s)
- Project area
- Corporate boundary
- Parcel

Source: Vivid, Maxar 1/19/2017